



Q+A 1  
6/5/24

Kuehling, Pamela &lt;pkuehling@stlwater.com&gt;

**Fwd: 24RFP026 City of St. Louis Chlorine Buildings Fire Alarm System Monitoring and Inspection Services**

1 message

Kuehling, Pamela &lt;pkuehling@stlwater.com&gt;

Wed, Jun 5, 2024 at 10:33 AM

To: Pamela Kuehling &lt;pkuehling@stlwater.com&gt;

Bcc:

Hi everyone,

Please see attached question and answer below regarding City of St. Louis Water Division 24RFP026 Chlorine Buildings Fire Alarm System Monitoring and Inspection Services. If you want a tour of the facilities, please call me to schedule an appointment.

Thanks,  
Pam

**Pamela Kuehling**  
**Contract Compliance Officer**  
**City of St. Louis Water Division**  
**1640 S. Kingshighway Blvd.**  
**St. Louis, MO 63110**  
**314-633-9003 phone**

**ANSWER:**

I have a drawing for Howard Bend I am attaching as long as cut sheets of items. The drawing shows what was replaced. The Chain is going to be done in a similar fashion and everything should be almost identical. If the prospective bidder needs to visit the sites they can do so.

**QUESTION:**

Thanks Pam, is there any documents that have a list of devices and panels?

**From:** Kuehling, Pamela <pkuehling@stlwater.com>**Sent:** Monday, June 3, 2024 11:07 AM**To:** Pamela Kuehling <pkuehling@stlwater.com>**Subject:** 24RFP026 City of St. Louis Chlorine Buildings Fire Alarm System Monitoring and Inspection Services

Hi,

If you are interested in submitting a proposal to win this contract, please see the attached copy or go to the City's website at

<https://www.stlouis-mo.gov/government/departments/public-utilities/water/documents/chlorine-building-fire-alarm-system-monitoring-and-inspection-services.cfm>

Thanks a lot, and please let me know if you have any questions.

Take care,

Pam

**Pamela Kuehling**

**Contract Compliance Officer**

**City of St. Louis Water Division**

**1640 S. Kingshighway Blvd.**


**St. Louis, MO 63110**


**314-633-9003 phone**


---

**11 attachments**


 **20210122\_Howard Bend Fire Alarm Project Drawings.pdf**  
1277K


 **PAD100-MIM.PDF**  
479K


 **PAD100-PD.PDF**  
390K


 **PAD100-SIM.PDF**  
524K


 **PAD100-PSSA-PSDA.PDF**  
621K


 **PAD100-HD.PDF**  
550K

 **SLP-HS.PDF**  
969K

 **PAD100-4DB-6DB.PDF**  
566K


 **AFC-1000.pdf**  
468K

 **PAD100-DIM.PDF**  
622K

 **HS\_S-24.pdf**  
851K

## Features

- One Class B contact monitoring input
- Small size allows mounting in most electrical boxes
- SLC Class A, Class X & Class B
- 6" Pigtail wiring connections
- Product includes a 5 year warranty
- UUKL Listed for Smoke Control

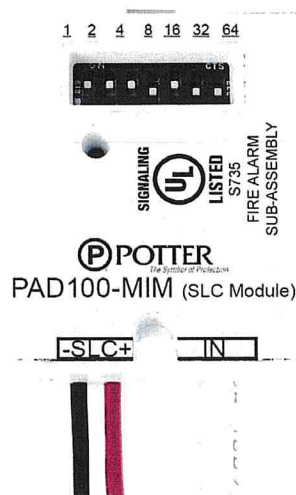

## Description

The PAD100-MIM is used to monitor the status of an initiating device(s) that contain a normally open set of dry contacts. The module is enclosed in a plastic case to protect against inadvertent shorts and ground faults. The case can be mounted using a single screw. The PAD100-MIM has a status indicator LED to indicate communication and alarm condition. In normal condition, the LED flashes when the device is being polled by the control panel. When the input is activated, the LED will flash at a fast rate.

## Application

The micro input module (PAD100-MIM) is compatible with Potter's IPA and AFC/ARC series addressable fire alarm control panels. Generally the PAD100-MIM is used to monitor pull stations and other devices where the module is installed in an electrical box or enclosure behind the device being monitored.

## Technical Specifications

Operating Voltage	24.0V
Max SLC Standby Current	200μA
Max SLC Alarm Current	200μA
IDC Input Circuit Wiring	Class B
Max Wiring Resistance of IDC	100 Ω
Max Wiring Capacitance of IDC	1μF
EOL Resistor	5.1K Ω
Operating Temperature Range	32 to 120°F (0 to 49°C)
Operating Humidity Range	0 to 93% (non-condensing)
Max no. of Module Per Loop	127 units
Dimensions	1.75" (44.5mm)L × 1.36" (34.5mm)W × .43" (11mm)D
Mounting Options	2-1/2" (64mm) deep single-gang box
Shipping Weight	0.3 lbs


## Setting the Address

Each addressable SLC device must be assigned an address. The address is set using the DIP switch located on the front of the PAD100-MIM. Before connecting a device to the SLC loop, take the following precautions to prevent potential damage to the panel or device:

1. Power to the device is removed.
2. Field wiring is correctly installed.
3. Field wiring has no open or short circuits.

## Wiring Diagram

Fig 1

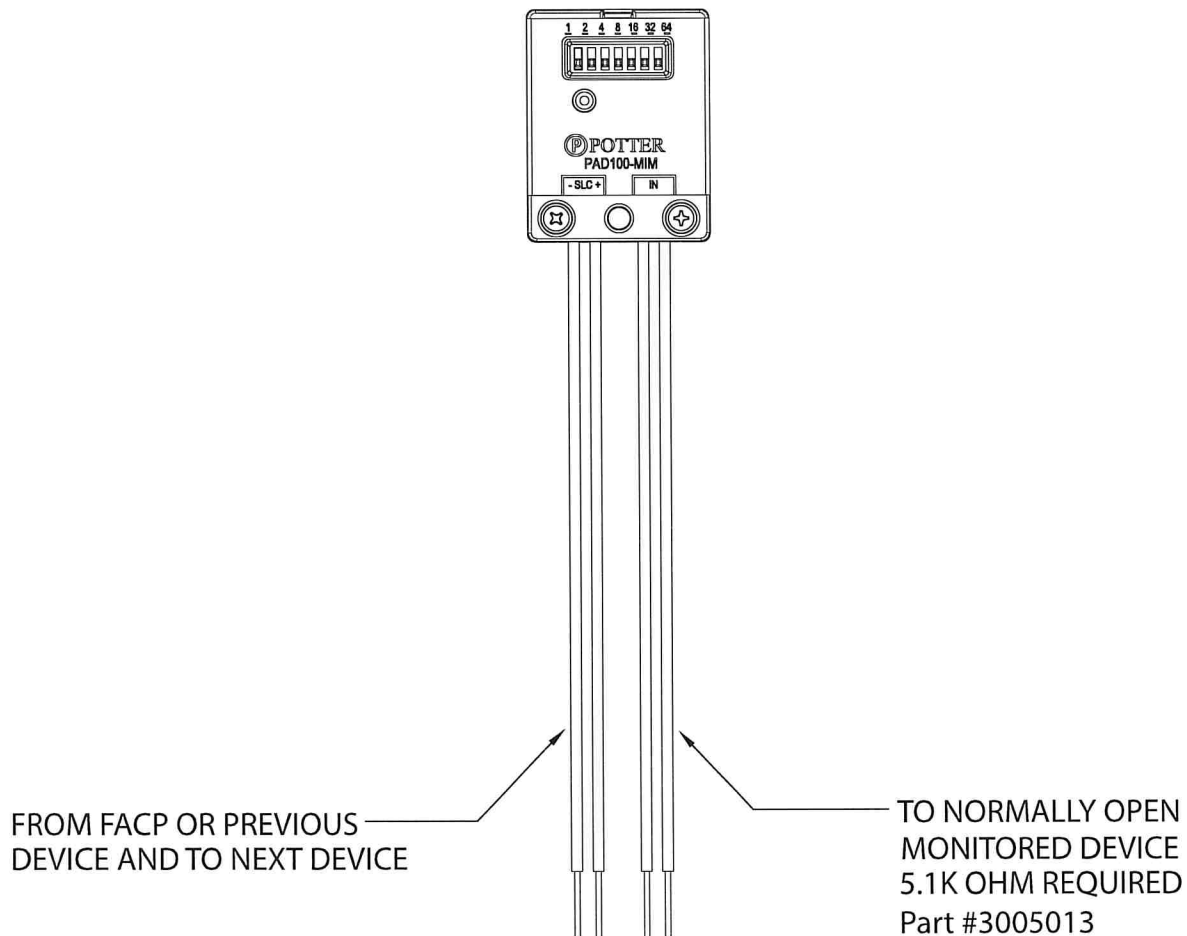


## Ordering Information

Model	Description	Stock No.
PAD100-MIM	Micro Input Module	3992700

## Features

- Low profile, less than 2 inches with the base
- Wide selectable sensitivity range of 1.0 to 3.7%/foot
- Sensor communicates sensitivity to control panel
- UL listed smoke calibration and sensitivity
- Optional locking tab to prevent unwanted removal
- Simple DIP switch address setting, no programming tool required
- LED alarm indicator
- Product includes a 5 year warranty
- UUKL Listed for Smoke Control

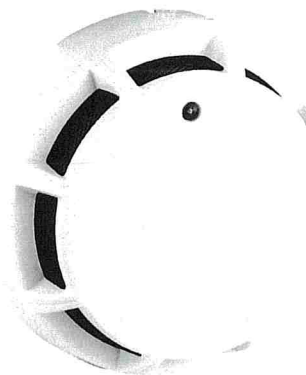

## Description

The Photoelectric Smoke Sensor is a listed Analog Addressable smoke sensor compatible with fire alarm control panels that utilize the Potter Addressable Device (PAD) protocol. The PAD100-PD is a low profile smoke sensor with a wide sensitivity range. The sensor and base (not included) are made of a durable plastic in an off-white color to blend in with the ceiling.

The PAD100-PD has a sensitivity range of 1.0 to 3.7 % per foot and is UL. The PAD100-PD features drift compensation and has built in dirty detector warning as well as. The PAD100-PD and the control panel communicate over a proven and robust digital communication path and the system analyzes the information at the particular device. The total polling speed is less than five (5) seconds, well under the UL requirements.

The sensor is compatible with any of the PAD series sensor bases and simply twists on. The PAD100-PD is addressed using DIP switches in the rear of the sensor and can be easily programmed in the field without special tools.

## Setting the Address

Each addressable device on the SLC loop must have a unique address from 1 to 127 to function properly. The address is set using DIP switches.

Before connecting a device to the SLC loop, take the following precautions to prevent potential damage to SLC or device. Verify the following:

1. Power to the device is removed
2. Field wiring is correctly installed.
3. Field wiring has no open or short circuits.

## Technical Specifications

Operating Voltage	24 VDC
Detector Current Draw	300 $\mu$ A
Alarm indicator	1 LED
Alarm set-point range	1.0 to 3.7 %/ft 3.6-12 %/m
Installation temperature range	32 to 120 ° F / 0 to 49 ° C
Operating relative humidity range	0% to 93% (Non-condensing)
Start-up time	Max. 1 sec.
Maximum number of addresses per loop	127
Maximum number of lighted indicators in alarm per loop.	30
Color	Eggshell White
Weight (without base)	101g (3.56oz)
Dimensions (without base)	Height: 1.35 in (34mm) Diameter: 3.93 in (100 mm)



## Air Velocity Ratings

The PAD100-PD has an Open Area of Protection air velocity rating of 0 to 300 feet per minute.

The system has a maximum of 30 LEDs that can be turned on simultaneously. If the system already has 30 LEDs on, the PAD100-PD will operate even though the LED may not illuminate.

## Operation

The PAD100-PD is an analog addressable sensor that uses one address on the Signaling Line Circuit (SLC) of a compatible fire alarm control panel. The unit communicates with the control panel as it is polled. The LEDs flash every time the unit is polled and they will flash at a fast rate if the unit is in an active status. The polling LED can be turned off if desired for less conspicuous operation.

The PAD100-PD with the PAD100-4DB or PAD100-6DB has a low profile of less than two (2) inches to blend into the surrounding environment. The sensor includes an insect screen to prevent foreign objects from reaching the chamber and the can be cleaned to restore operation of a dirty detector.

## Sensor Sensitivity

The PAD100-PD and the compatible control panel work in tandem to keep the sensitivity consistent. As the sensor is installed over time, the sensor compensates for the dirt in the unit until it is out of range. At that time, the panel will indicate a dirty sensor. The sensor will then have to be cleaned or replaced.

The PAD100-PD can be programmed to provide a maintenance alert prior to reaching the dirty sensor level which will allow for intervention prior to the sensor going into trouble. This allows for sensor replacement or cleaning prior to a nuisance trouble occurs.

**NOTE:** As required by NFPA, do not install the sensors until all construction is complete and the work area has been thoroughly cleaned. If the sensors have been installed in a construction environment, they should be cleaned or replaced before the system is placed into service.

## Spacing

The PAD100-PD is UL listed with a recommended maximum spacing of 30 feet. Refer to NFPA 72 for specific information regarding detector spacing, placement and special applications.

## Compatible Bases

All bases will mount on a single gang, double gang, octagon, 4" square or mud ring electrical box.

Device	Description	Stock No.
PAD100-4DB	4" Standard Base	3992731
PAD100-6DB	6" Standard Base	3992732
PAD100-IB	6" base with an isolator module included.	3992730
PAD100-RB	6" base with one Form-C relay contact. 2A @ 30VDC, 0.5A @ 125VAC	3992728
PAD100-SB	6" base with sounder module included. Sound pattern is provided from external source.	3992729
PAD100-SPKB	6" base with speaker included	3992762


## Ordering Information

Model	Description	Stock No.
PAD100-PD	Photoelectric Smoke Sensor	3992733

## Features

- One (1) Class B monitoring input
- SLC Class A, Class X & Class B
- Mounts in a standard 4" or double gang box
- Wiring terminals accessible when mounted in box
- All wiring terminals accept 22 to 12 AWG
- Product includes a 5 year warranty
- UUKL Listed for Smoke Control

**NOTE:** This addressable module does not support 2-wire smoke detectors.

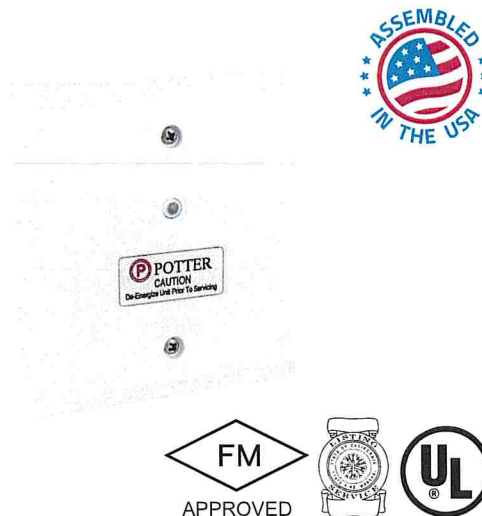

## Description

The PAD100-SIM uses one (1) SLC loop addresses when monitoring one (1) Class B circuit. The module mounts on either a 4" square or double gang box. The module is capable of monitoring one (1) Class B circuit. The PAD100-SIM includes one red LED to indicate the module's status. In normal condition, the LED flashes when the device is being polled by the control panel. When the input is activated, the LED will flash at a fast rate.

## Application

The PAD100-SIM is compatible with Potter's IPA and AFC/ARC series addressable fire alarm control panels. The PAD100-SIM is an interface module used to monitor dry contact devices such as sprinkler waterflow, valve tamper switches, or conventional pull stations. The module is capable of monitoring one Class B circuit.

## Setting the Address

Each addressable SLC device must be assigned an address. The address is set using the DIP switch located on the PAD100-SIM.

Before connecting a device to the SLC loop, take the following precautions to prevent potential damage to the panel or device:


1. Power to the device is removed.
2. Field wiring is correctly installed.
3. Field wiring has no open or short circuits.

## Technical Specifications

Operating Voltage	24.0V
Max SLC Standby Current	240μA
Max SLC Alarm Current	240μA
Max Wiring Resistance of IDC	100Ω
Max Wiring Capacitance of IDC	1μF
EOL Resistor	5.1K Ω
Operating Temperature Range	32 to 120°F (0 to 49°C)
Operating Humidity Range	0 to 93% (non-condensing)
Max no. of Module Per Loop	127 units
Dimensions	4.17" (106mm)L × 4.17" (106mm)W × 1.14" (29mm)D
Mounting Options	Standard 4" Square or Double Gang Box
Shipping Weight	0.6 lbs

## Installation Using Compatible Electrical Box


Fig 1

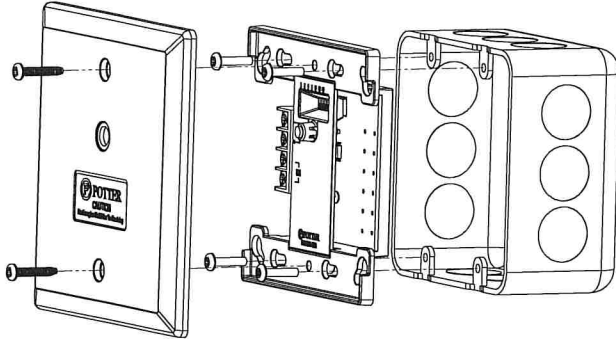

## Wiring Diagram

PAD100-SIM With Class B Circuit

Fig 2

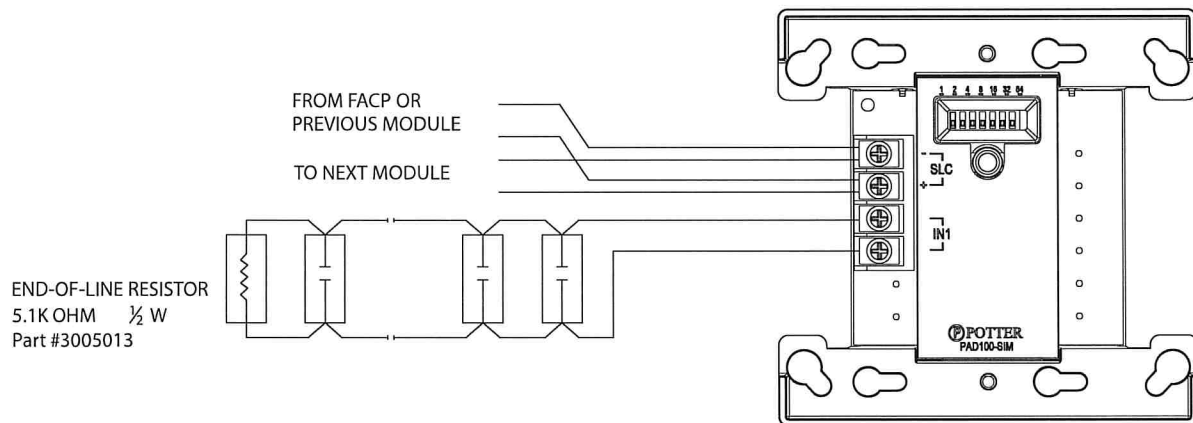


## Ordering Information

Model	Description	Stock No.
PAD100-SIM	Single Input Module	3992704



## Features

- Single or Dual Action versions
- Durable die-cast construction
- Reset key matches the fire alarm control panels
- Compatible with IPA Series panels
- SLC Class A, Class X & Class B
- Product includes a 5 year warranty
- UUKL Listed for Smoke Control

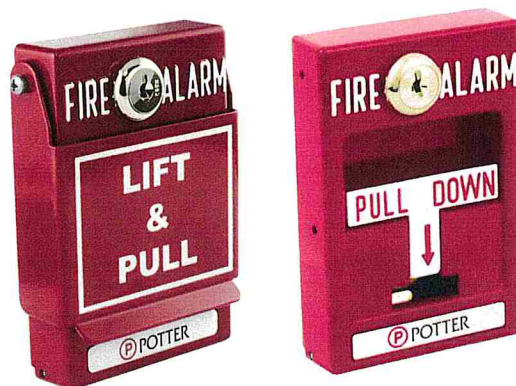

## Description

The PAD100-PSSA (Single Action) is activated by simply pulling the white “T” bar handle down. The PAD100-PSDA (Dual Action) is activated by lifting the front cover and then pulling the white “T” bar handle down. Once activated, the “T” bar cannot be reset without opening the front cover. Opening the front cover will also activate the pull station. To reset the PAD100-PS Series, use the Potter WS-93 key to unlock and open the front cover. Once the cover is open, push the “T” bar back into the normal position and re-secure the front cover.

## Application

The PAD100-PSSA/PSDA is compatible with Potter’s IPA and AFC/ARC series addressable fire alarm control panels. It is a non-coded addressable pull station available in either a single or dual action model and installs on a single gang box or surface mounts using the P32-BB or P32-DBB (deep) back box.

## Technical Specifications


Operating Voltage	24.0 VDC
Max SLC Standby Current	200uA
Max SLC Alarm Current	200uA
Environmental Limitations	32°F - 120°F (0° - 49°C) Indoor Only
Dimensions	4.75” H x 3.25” W x 1.75” D
Relative Humidity Range	0 - 93% (non-condensing)
Mounting Options	Single gang box or Potter P32-BB/DBB
Shipping Weight	APS-SA - 1.22 lbs. APS-DA - 1.46 lbs.

## Setting the Address

The PAD100-PS Series uses one SLC address assigned to the device. The address is set using the DIP switch located on the back of the PAD100-PS device.


### Pull Station Front View

Fig 1

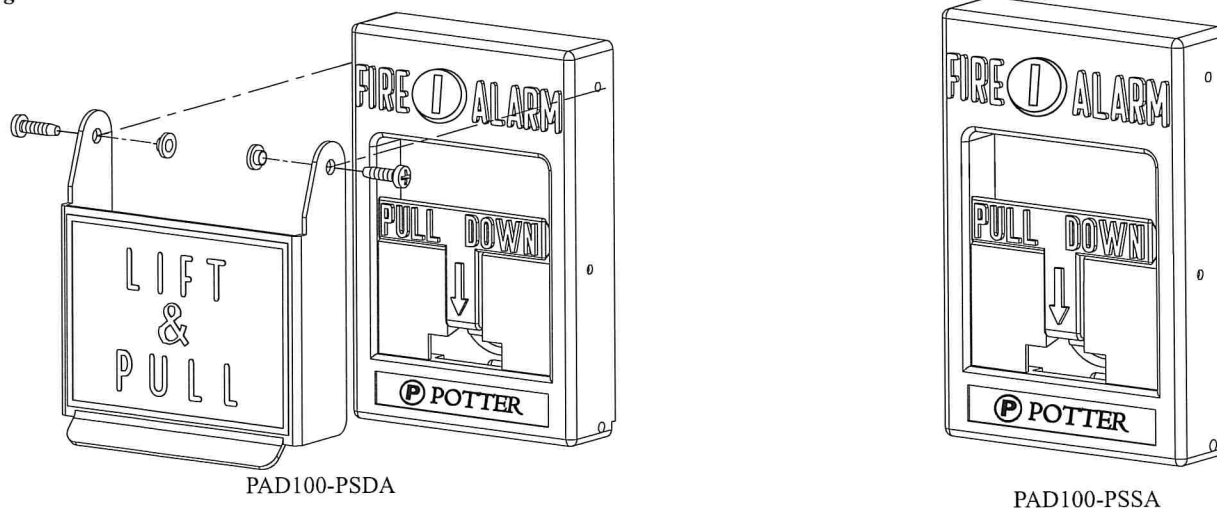

### Pull Station Back View and Wiring

Fig 2

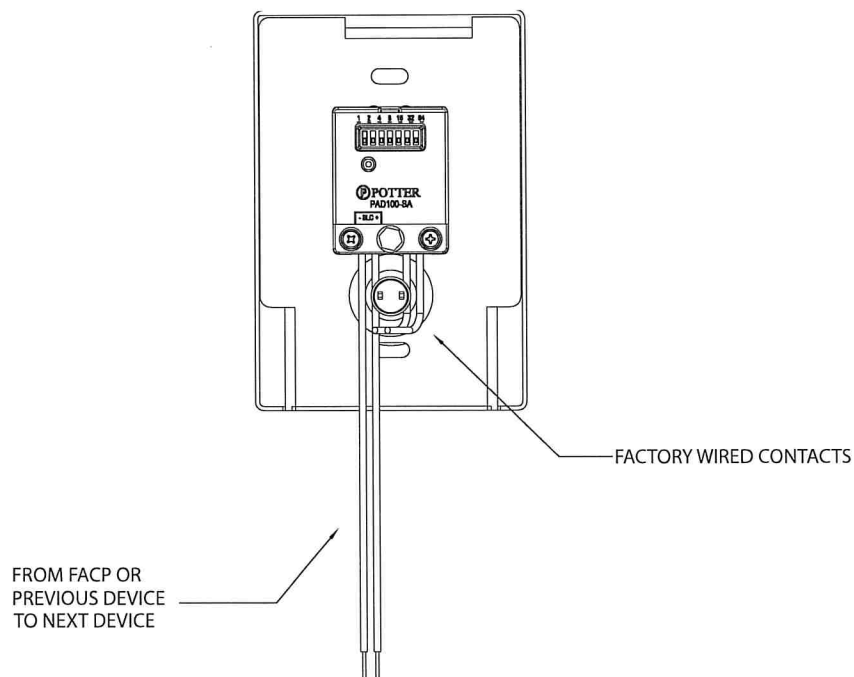


## Ordering Information

Model	Description	Stock No.
PAD100-PSSA	Addressable Pull Station, Single Action	3992721
PAD100-PSDA	Addressable Pull Station, Dual Action	3992720

## Features

- Selectable Rate of Rise and/or Fixed Heat Detector
- Low profile
- Reliable detection technology
- LED Alarm Indicator
- Ambient temperature listing of 32° F to 150° F
- Simple DIP switch address setting, no programming tool required
- Product includes a 5 year warranty
- UUKL Listed for Smoke Control

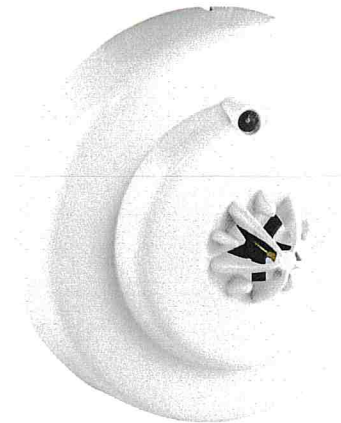

## Description

The PAD100-HD is a listed Analog Addressable rate of rise and/or fixed temperature heat sensor compatible with any fire alarm control panel that has the Potter Addressable Device (PAD) protocol. The heat sensing portion utilizes a proven thermistor for accurate and reliable heat detection. The sensor and base (not included) are made of a durable plastic in an off white to blend in with the ceiling.

The PAD100-HD is UL listed with a selectable fixed temperature point from 135° to 185° Fahrenheit and can be used for rate of rise applications. See detector spacing limitations below. This flexibility allows the installer to cover a wide variety of applications with a single unit.

The PAD100-HD and the control panel communicate over a proven and robust digital communication path and the system analyzes the information at the particular device. The total polling speed is less than five (5) seconds, well under the UL requirements.

The sensor is compatible with any of the PAD series sensor bases and simply twists on. The PAD100-HD is addressed using DIP switches in the rear of the sensor and can be easily programmed in the field without special tools.

## Setting the Address

Each addressable device on the SLC loop must have a unique address from 1 to 127 to function properly. The address is set using DIP switches.

Before connecting a device to the SLC loop, take the following precautions to prevent potential damage to SLC or device. Verify the following:

1. Power to the device is removed
2. Field wiring is correctly installed.
3. Field wiring has no open or short circuits.

## Technical Specifications

Operating Voltage	24 VDC
Detector Current Draw	300 $\mu$ A
Alarm indicator	1 LED
Alarm set-point range	135 to 185 °F/ 57 to 85 °C
Rate of Rise Detection (Selectable Option)	15°F/min. (8.3°C/min.)
Installation temperature range	32 to 150 °F / 0 to 66 °C
Operating relative humidity range	0% to 93% (Non-condensing)
Start-up time	Max. 1 sec.
Maximum number of addresses per loop	127
Maximum number of lighted indicators in alarm per loop	30
Color	Eggshell White
Weight (without base)	82g (2.89 oz)
Dimensions (without base)	Height: 1.94 in (49mm) Diameter 3.93 in (100mm)



## Operation

The PAD100-HD is an analog addressable sensor that uses one address on the Signaling Line Circuit (SLC) of a compatible fire alarm control panel. The unit communicates with the control panel as it is polled. The LED flashes every time the unit is polled and will flash at a fast rate if the unit is in an active status. The polling LED can be turned off if desired for less conspicuous operation.

The PAD100-HD with the PAD100-4DB or PAD100-6DB has a low profile to blend into the surrounding environment. The system has a maximum of 30 LEDs that can be turned on simultaneously. If the system already has 30 LEDs on, the PAD100-HD will operate even though the LED will not illuminate.

## Spacing

The ANSI/UL listed spacing limitations of PAD100-HD smooth ceiling are dependent on alarm set point.

Alarm Set-Point	Rate of Rise Spacing	Fixed Temperature Spacing
135°F to 160°F (57°C to 71°C)	Max. 70 ft.	Max. 70 ft.
161°F to 174°F (72°C to 79°C)	Max. 60 ft.	Max. 60 ft.
175°F to 185°F (80°C to 85°C)	Max. 15 ft.	Max. 15 ft.

## Compatible Bases

All bases will mount on a single gang, double gang, octagon, 4" square or mud ring electrical box.

Device	Description	Stock No.
PAD100-4DB	4" Standard Base	3992731
PAD100-6DB	6" Standard Base	3992732
PAD100-IB	6" base with an isolator module included.	3992730
PAD100-RB	6" base with one Form-C relay contact. 2A @ 30VDC, 0.5A @ 125VAC	3992728
PAD100-SB	6" base with sounder module included. Sound pattern is provided from external source.	3992729
PAD100-SPKB	6" base with speaker included	3992762

## Ordering Information

Model	Description	Stock No.
PAD100-HD	Fixed Temperature Heat Sensor	3992735



## Features

- Fixed 75cd strobe
- Includes the WPBB surface-mount (standard) or WPLPBB Low Profile (LP) enclosure
- WPBB/LP made of clear Lexan® - provides maximum visibility and reliability, allowing full 75cd output
- Super-Slide® Bracket – Ease of supervision testing
- Checkmate® - Instant voltage verification
- Synchronize strobe and/or horn with AVSM module
- Switch selection for high/low dBA
- Switch for chime, whoop, mechanical, and 2400Hz tone
- Input terminals accept 18 to 12 AWG
- Switch for continuous or temporal 3 tone (not available on whoop)
- Tamperproof re-entrant grill
- 5 year warranty



LP Version

Standard



## Application

The S/HS-WP Series Outdoor Signals are wall mount, low profile strobes and horn/strobes that offer dependable audible and visual alarms for warning and emergency notification in outdoor locations.

## Description

The S/HS-WP Series Outdoor Signals are 24VDC strobes and horn/strobes equipped with a fixed 75 candela strobe.

This series of outdoor signals are available in two different versions. The standard version includes a surface-mount back box (WPBB) to install directly on a wall. The Low Profile (LP) versions includes a low profile back box (WPLPBB) designed to be installed on a flush-mounted electrical box. The weatherproof enclosure is made of clear Lexan® which provides maximum visibility and reliability for effective visible signaling, allowing full 75cd output.

The S/HS-WP series strobe has a minimal operating current and a minimum flash rate of 1Hz regardless of input voltage. The strobe is synchronized using Gentex sync. protocol or the AVSM Sync. Module.

The S/HS-WP Series is equipped with a universal 4" mounting bracket which incorporates the popular Super-Slide® feature that allows the installer to easily pre-wire the system and test for supervision. The product also features a locking mechanism that secures the signal to the bracket without showing any screws and the Checkmate® - Instant Voltage Verification Feature which allows the installer to check the voltage drop, current draw, and match against the blue print.

## Product Listings

- ANSI/UL 464 and 1638
- Complies with American with Disabilities Act (ADA)
- Complies with IBC / IFC / IRC

## Technical Specifications

Operating Voltage	Nominal 24VDC (16-33VDC)
Operating Temperature	-31°F - 150°F (-35° - 66°C)
Dimensions	LP Version - 5.75" H x 4.75" W x 3.25" D Standard - 5.75" H x 4.75" W x 4.18"D
Wiring Connections	Terminals accept 18 - 12 AWG
Mounting	LP Version – Single gang, double gang, or 4" square back box Standard Version - Surface mount back box included
Shipping Weight	2.05 lbs.

**S-24-WP, 75 Candela, Outdoor Strobe**  
Includes Standard or LP Enclosure

Model Number	Stock Number	Body Color	WP Enclosure
S-24WR-WP	4890050	Red	Standard
S-24WW-WP	4890051	Off-White	Standard
S-24PWR-WP	4890052	Red-Plain	Standard
S-24PWW-WP	4890053	Off-White-Plain	Standard
SLP-24WR-WP	4890054	Red	Low Profile
SLP-24WW-WP	4890055	Off-White	Low Profile
SLP-24PWR-WP	4890056	Red-Plain	Low Profile
SLP-24PWW-WP	4890057	Off-White-Plain	Low Profile

## Model Designations

“W” = Wall Mount

“R” = Red Face Plate

“W”=Off - White Face Plate

“P”= Plain (Note: Plain units are non-returnable)

“LP”= Low Profile (WPLPBB Enclosure)

### Strobe Current Ratings

Candela	75 cd
24 VDC	112 mA
UL Max	170 mA

**NOTE:** For unfiltered FWR ratings, see installation manual.

**HS-24-WP Series, 75 Candela, Outdoor Horn /Strobe**  
Includes Standard or LP Enclosure

Model Number	Stock Number	Body Color	Reverberant dBA at 10', per ANSI/UL 464	In Anechoic Room dBA at 10'	WP Enclosure
HS-24WR-WP	4890060	Red	70-82	100	Standard
HS-24WW-WP	4890061	Off-White	70-82	100	Standard
HS-24PWR-WP	4890062	Red-Plain	70-82	100	Standard
HS-24PWW-WP	4890063	Off-White-Plain	70-82	100	Standard
HSLP-24WR	4890064	Red	70-82	100	Low Profile
HSLP-24WW	4890065	Off-White	70-82	100	Low Profile
HSLP-24PWR	4890066	Red-Plain	70-82	100	Low Profile
HSLP-24PWW	4890067	Off-White-Plain	70-82	100	Low Profile

### Horn Decibel and Current Ratings

Horn Setting	Minimum dBA at 10', Per UL 464 (HIGH)	Minimum dBA at 10', Per UL 464 (LOW)	Regulated 24VDC Max. Operating Current, at High Setting (mA)
Temporal 3 2400Hz	78	71*	28
Temporal 3 Mechanical	76	70*	25
Temporal 3 Chime	70*	66*	15
Continuous 2400Hz	81	74*	28
Continuous Mechanical	80	72*	25
Continuous Chime	70*	66*	15
Whoop	82	69*	56

\*Operating the horn in this mode at this voltage will result in not meeting the minimum ANSI/UL 464 reverberant sound level required for public mode fire protection service. These settings are acceptable only for private mode fire alarm use. Use the high dBA setting for public mode application (not applicable when using the chime tone. The chime tone is always private mode).



## Tone Switch Locations


Tone	Switch Position		
	3	4	5
Mechanical Temporal 3	ON	ON	ON
Mechanical - Continuous	OFF	ON	ON
2400Hz - Temporal 3	ON	OFF	ON
2400Hz - Continuous	OFF	OFF	ON
Chime - Temporal 3	ON	ON	OFF
Chime - Continuous	OFF	ON	OFF
Whoop	ON	OFF	OFF
Whoop	OFF	OFF	OFF

### NOTES:

- Switch Positions 1 and 2 in the OFF position to select isolated horn and strobe power inputs
- Switch Position 6 ON = HIGH dBA
- Switch Position 6 OFF = LOW dBA

### Super Slide® Mounting Bracket

Allows the installer to pre-wire the system, test for system supervision, remove the signal head until occupancy, switch out signals without changing mounting brackets and has locking edge connector for snap-in-place installation.

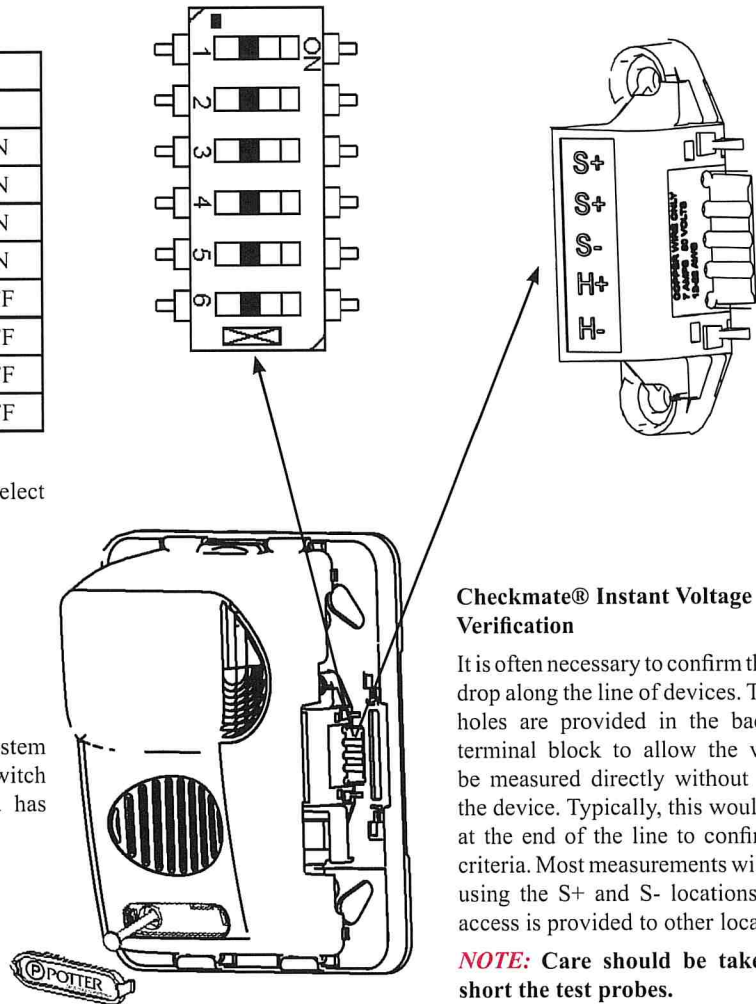

### Checkmate® Instant Voltage Verification


It is often necessary to confirm the voltage drop along the line of devices. The access holes are provided in the back of the terminal block to allow the voltage to be measured directly without removing the device. Typically, this would be done at the end of the line to confirm design criteria. Most measurements will be taken using the S+ and S- locations although access is provided to other locations.

**NOTE:** Care should be taken to not short the test probes.

## Mounting Outdoor Enclosure


Super Slide® Mounting Plate:

Mounts to WPBB Outdoor Enclosure

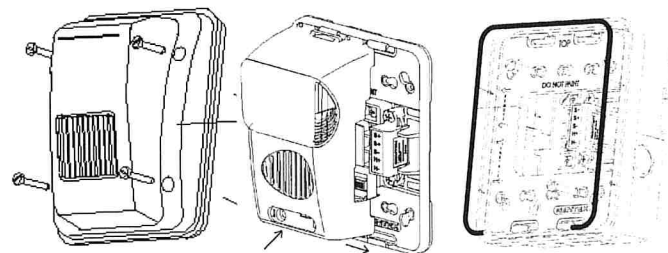


Super Slide® Mounting Plate:

Mounts to WLPBB Outdoor Enclosure

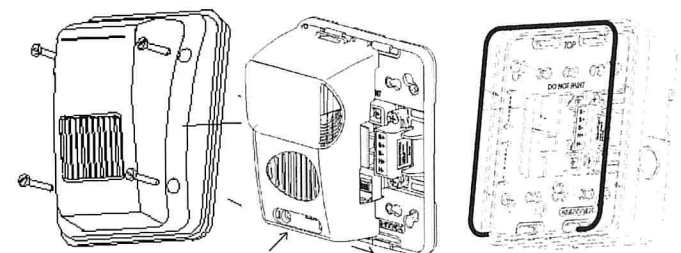

## Wiring Diagrams

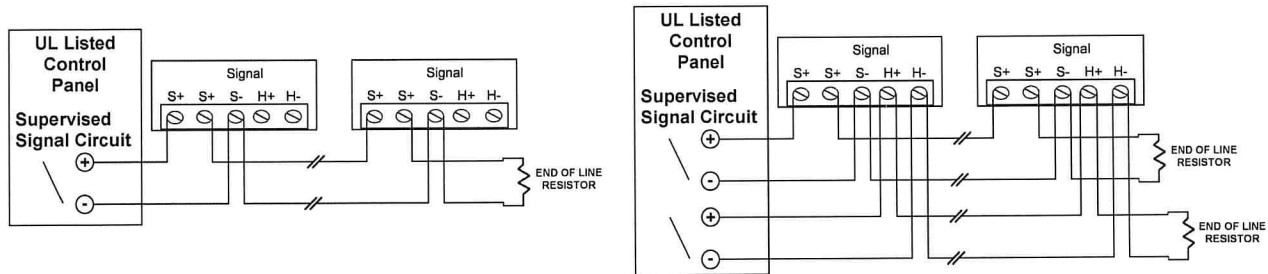

### NOTES:

- All strobes are designed to flash as specified with continuous applied voltage. Strobes should not be used on coded or pulsing signaling circuits. However, use of the AVSM control module or Gentex synchronization protocol is permitted to synchronize the strobe, horn and/or mute the horn.
- FOR SYNCHRONIZATION WIRING INFORMATION, REFERENCE AVSM CONTROL MODULE DATA SHEET (8830050) AND/OR AVSM CONTROL MODULE MANUAL FOR SYNCHRONIZATION MODULE WIRING DIAGRAMS. AVSM CONTROL MODULE DATA SHEET AND MANUAL CAN BE OBTAINED AT <http://pottersignal.com> OR CALL POTTER ELECTRIC AT 1-800-325-3936.**

## Architect and Engineering Specifications

The audible and/or visible signal shall be Potter S/HS-WP Outdoor Series or approved equal and shall be listed by Underwriters Laboratories Inc. per ANSI/UL 1638 and/or ANSI/UL 464.

The notification appliance (combination audible/visible) shall produce a peak sound output of 100dBA or greater at as measured in an anechoic chamber. The signaling appliance shall also have the capability to silence the audible signal while leaving the visible signal energized with the use of a single pair of power wires. Additionally, the user shall be able to select either continuous or temporal tone output with the temporal signal having the ability to be synchronized.

The audible/visible and visible signaling appliance shall also maintain a minimum flash rate of 1Hz or up to 2 Hz regardless of power input voltage. The appliance shall have an operating current of 112mA or less for the 75Cd strobe circuit. The appliance shall also be capable of meeting the candela requirements of the ADA (75cd).

The appliance shall be polarized to allow for electrical supervision of the system wiring. The unit shall be provided with a mounting bracket with terminals with barriers for input/output wiring and be able to mount to a single gang or double gang box or double workbox without the use of an adapter plate. The unit shall have an input voltage range of 16-33 volts with either direct current or full wave rectified power for 24 volt models.

The appliance shall be capable of testing supervision without disconnecting wires. Also the appliance shall be capable of mounting to a surface back box. The unit shall also be able to verify voltage at the unit without removing unit.

The appliance has extended temperature range of -31° to 150°F (-35° to 66° C). The appliance shall satisfy virtually all outdoor and severe environment applications. The WPBB enclosure includes a gasket that must be inserted between the box and mounting bracket. There are drain holes in the back box to allow for drainage, the seal on the WPBB enclosure is not water tight. The WPLPBB enclosure includes a weather seal for mounting to wall and intended for use with universal electrical box. To allow for drainage, bottom edge of enclosure is not water tight.



## Features

- Terminals Marked with Polarity to assist with installation
- Duplicate terminals for in and out SLC wiring
- Terminals accept 22 to 12 AWG wire sizes
- Installs on single gang, double gang, octagon or 4" square box
- Locking tab prevents unauthorized detector removal
- Product includes 5 year warranty



## Application

The Potter PAD100-6DB and PAD100-4DB detector bases are used to install Potter's addressable smoke and heat detectors. The PAD100-6DB will mount on a single gang, double gang, octagon or 4" square electrical box.

## Description

The PAD100-6DB and PAD100-4DB are low-profile, surface mount bases used with Potter's addressable detectors. The base uses screw-clamp terminals that accept wire ranging from 22 to 14 AWG. When installed on recessed electrical boxes the PAD100-6DB is wide enough to completely cover the back box and the immediate surrounding area. The base is equipped with a locking tab to deter unauthorized removal of the attached detector.

## Technical Specifications


Mounting Options	Single gang, double gang, octagon, and 4" square box
Terminals	Screw-Clamp Type
Wire Gauge	22 to 12 AWG
Dimensions	Diameter: 6.3 in (166 mm) Height 0.72 in (18 mm)
Shipping Weight	87g (3.07 oz)
Material	Durable Plastic

## Locking Feature

The PAD100-6DB and PAD100-4DB include a locking feature that prevents removal of the detector without using a tool.


1. To eliminate this feature, break off the locking tab (refer to Figure 1), and then install the detector.

**Fig. 1**

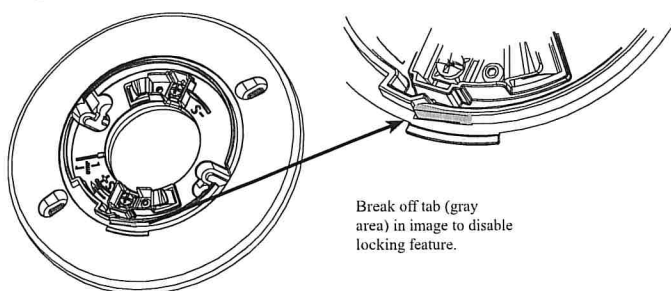


2. To remove the detector from the base when the locking feature has been enabled, insert a small screw driver into the slot on the base to push the plastic tab while simultaneously turning the detector head counter-clockwise.

**Fig. 2**

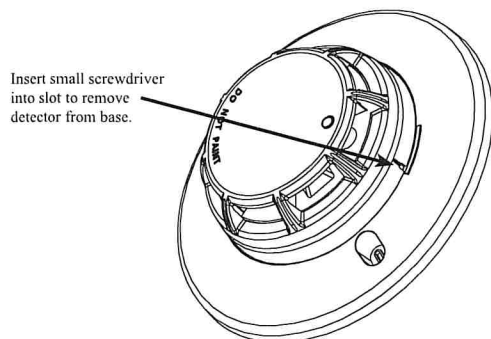

## Wiring Diagram

**Fig. 3**

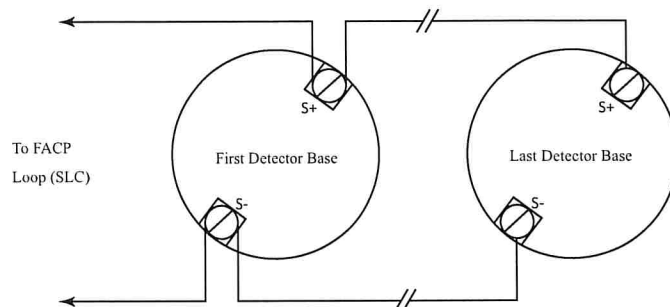

## Ordering Information

Model	Description	Stock No.
PAD100-6DB	6" Sensor Base	3992732
PAD100-4DB	4" Sensor Base	3992731

## Features

- 1,270 addresses available on this analog addressable system
- Additional system capacity achieved via multi-point SLC modules
- 1500 software zones
- NFPA 72 Compliant Smoke Sensitivity Test Built-In
- System Operates as Class A or Class B for SLC, P-Link and NACs
- 10 Amp Power Supply, Expandable to 315 amps
- 6 NACS, Regulated, Rated at 3 Amps each, expandable to 192
- 4 Input/Output (I/O) Circuits for system flexibility rated at 1 Amp each
- Strobe Synchronization and System Wide Sync for Gentex®, AMSECO®, Cooper Wheelock® and System Sensor® strobes
- Dedicated Alarm, Supervisory and Trouble Relays
- 4,000 Event History Buffer
- Optional two line DACT with UD-2000 that can report General, Zone or Point Information
- Built in IP communicator
- Ethernet Port for Programming and Network Connectivity
- E-Mail System Status, Reports and Event Information
- Product includes 5 year warranty



NYC Fire Dept.  
Certificate of Approval  
6256



7165-0328:0509 S735

## Description

The AFC-1000 is an expandable analog/addressable releasing fire alarm system with a total system capacity of 1270 addresses. Additional capacity on the system is achieved using multi-point SLC modules. The control panel utilizes the exclusive Potter protocol that includes a complete line of sensors and modules. Each SLC may be comprised of any combination of smoke sensor, heat detectors or modules and allows for a total of 50 ohms of impedance and may use any wire compliant with the National Electrical Code (NEC).

The AFC-1000 has a 10 Amp power supply with six Notification Appliance Circuits (NACs) and four Input/Output (I/O) circuits. The NACs are rated at 3 Amps each and the I/Os are rated at 1 Amp each. Each output is regulated and power limited. In addition, each output is uniquely programmable and may be configured for steady signal, strobe synchronization, constant power, door holder power, or releasing. The strobe synchronization includes Gentex, AMSECO, System Sensor and Cooper/Wheelock and with the exclusive Quadrasync each output may have a unique brand and all strobes will flash together.

The NACs may be expanded using the PSN-1000 series intelligent power supplies. Each PSN-1000 adds another 10 Amps of power, 2 additional input circuits and the AFC-1000 will support up to 31 power supplies. The system will synchronize the strobes system wide. In addition, the PSN-1000E has space to allow the installation of up to six PAD100-SLCE SLC loop expansion cards. The cards mount on a stacker bracket that allows access to all SLC circuit connections.

## Technical Specifications

Dimensions	18 <sup>15</sup> / <sub>16</sub> "W x 27 <sup>5</sup> / <sub>16</sub> "H x 4 <sup>7</sup> / <sub>16</sub> "D
AC Mains	5.0 Amps @ 120 VAC 50/60 HZ 3.0 Amps @ 240 VAC 50/60 HZ
Enclosure	16 gauge cold rolled steel with removable locked door with Lexan viewing window
Battery	Standby Current-130 mA Alarm Current-220 mA <ul style="list-style-type: none"> <li>• 10 Amps power for NACs, I/O, and P-Link</li> <li>• 3 Amps per NAC, regulated</li> <li>• 1 Amp per I/O circuit, regulated</li> <li>• Battery Charger range 8-55 Ah</li> <li>• Battery Charger voltage 27.3 VDC</li> <li>• P-Link maximum current of 1 Amp</li> </ul>
Temperature and Humidity Range	32° to 120° (0°C to 49°C) with a maximum humidity of 93% non-condensing.



### SLC Loop Accessories

The control panel may be connected with up to 1,270 addressable devices or modules in any combination. The SLC is not restricted by any special wire requirements and may be wired with any wire that complies with the NEC.

### SLC Loop Devices

Device	Description
PAD100-PD	Analog Photo Electric Smoke Detector is a smoke detector with a listed obscuration of 1.02 to 3.83 percent per foot.
PAD100-PHD	Combination Analog Photo Electric Smoke/Heat Detector – a smoke detector with a listed obscuration of 1.02 to 3.83 percent obscuration and a fixed temperature 135° Fahrenheit heat detector.
PAD100-HD	Analog Fixed (135d-185dF) or Rate-of-Rise Heat Detector (software selectable)
PAD100-DUCTR	Addressable Duct Smoke Detector with Form C Relay. Addressable Duct Smoke Detector with Form C relay rated at 10a @ 250/120VAC or 8amps at 30VDC.
PAD100-DUCT	Addressable Duct Smoke Detector.
PAD100-6B	6" round base that is mounted to an electrical box and wired for connection of one of the above sensors.
PAD100-4B	4" round base that may be mounted to an electrical box and wired for connection to the above sensors.
PAD100-IB	Isolator base that interrupts a short in a SLC and prevents the short from affecting protected devices on the loop.
PAD100-RB	Addressable Relay Base that contains one relay controlled by the SLC. Relay is rated at rated at 2 amps at 30 VDC or 0.5A at 125VAC.
PAD100-SB	Addressable Sounder Base that contains an addressable sounder module that may be configured for local, group and all call.
PAD100-CD	Addressable CO gas detector.
PAD100-DD	Addressable photo electric smoke detector for use in DUCT/DUCTR enclosure.
PAD100-LFSB	Addressable Low Frequency Sounder Base that contains an addressable sounder module that may be configured for local, group and all call. The LFSB complies with the Low Frequency Signal Requirements (520 Hz)
PAD100-SPKB	Speaker base is a wall or ceiling mount speaker capable of 25 or 70.7 VRMS and is field selectable from 1/8W to 4W.

### Modules

Device	Description
PAD100-MIM	Micro Input Module provides a small foot print contact module for mounting inside an enclosure.
PAD100-PSSA	Single Action Addressable Pull Station.
PAD100-PSDA	Dual Action Addressable Pull Station.
PAD100-SIM	Single Input Module is a standard contact module with an LED that mounts into a 4" square electrical box.
PAD100-DIM	Dual Input Module is a device that can monitor two distinct inputs with a single device or in a Class A mode.
PAD100-TRTI	Two Relay Two Input module provides two form C relays that are individually controlled by the control panel. Each relay is rated for 2 amps at 30VDC or 0.5 amps at 125VAC. Also provides two contact inputs.
PAD100-NAC	Notification Appliance Circuit module is an addressable remote appliance circuit controlled by the panel.
PAD100-ZM	Zone Module is used to connect conventional 2-wire smoke detectors to the system.
PAD100-IM	Module interrupts a short on the SLC and prevents the short from affecting protected devices on the loop.
PAD100-RM	Relay Module that provides one form C relay controlled by the control panel. Relay is rated for 2 amps at 30VDC or 0.5 amps at 125VAC.
PAD100-LED	Module provides a single addressable LED that is controlled by the control panel.
PAD100-SM	Speaker Module provides switching for two audio channels.
PAD100-LEDK	Addressable LED and key switch that mounts in a single gang box.
PAD100-DRTS	DUCTR Remote Test Switch that mounts in a single gang box and optionally supervised. For use with the PAD100-DUCTR only.
PAD100-OROI	One Relay One Input Module provides one form C relay and one input. The relay is rated at 2 amps at 30VDC or 0.5 amps at 125VAC.



## SLC Features

The Potter protocol is a digital protocol with a proven design for reliability and noise immunity. The system does not require special cable or conductors for connection of the Signaling Line Circuit as long as the cable is compliant with NFPA 70 and NFPA 72. The system allows for Class A or Class B installations as well as "T-Taps." Each loop is capable of 127 points, with a max wiring distance of 10,000 ft.

## Sensor Features

The sensors through the fire alarm control panel provide a real time status as to the condition of the system. The smoke detector sensitivity, heat detector temperature level and drift compensation are all programmable options. The system also allows for a day/night mode where the panel automatically adjusts the sensitivity depending on the time of day. To assist in the reduction of false alarms, the smoke detectors also have a maintenance warning that sends a trouble signal when a detector is dirty to the point that it can no longer maintain the programmed sensitivity.

## User Interface

The fire alarm control panel has a 4 x 40 LCD display to provide information to the system status. The keypad has navigation keys to allow manipulation of the Menu on board the panel. The panel is shipped standard with the following LEDs:

- AC Power - Green
- Alarm - Red
- Earth Fault - Amber
- Supervisory - Amber
- Silenced - Amber
- Trouble - Amber
- Pre-Release - Amber
- Release - Red

The common buttons include a Silence, Reset, Acknowledge, and Drill. All of the buttons are accessible once the locked door is opened.

## P-Link

The AFC-1000 has a proprietary communication protocol that communicates through a RS-485 connection to field devices. Up to 64 devices may be connected to a single P-Link connection. The P-Link includes the communication terminals and regulated 24 VDC connection for the field devices. The field devices may be any of the following:

**PAD100-SLCE**-Analog/Addressable loop expansion module

**SLCE-127** -Nohmi addressable loop expansion module for retrofit applications.

**RA-6075R** – 2 x 16 LCD annunciator with a key pad in a locked metal enclosure.

**RA-6500R(F)** – 4 x 40 LCD annunciator with a key pad in a locked metal enclosure. Flush mount version available.

**LED-16(F)** – 16 LED annunciator with common indicators in a locked metal enclosure. Flush mount version available.

**PSN-1000(E)** – 10 amp, remote intelligent power supply with 6 NACs, 2 Inputs and a P-Link repeater. This panel is listed in conjunction with the AFC-100 as releasing circuits

**CA-6500** – Class A convertor that converts the SLC, NACs and P-Link connection

**UD-2000** – UL listed, Dual line telephone alarm communicator

**DRV-50** – LED driver expander, used to connect up to 50 LEDs in a graphic display

**FCB-1000** – Fire communication bridge, provides remote mounting of the Ethernet connection

**FIB-1000** – Fiber interface module, used to extend P-Link to multi-mode fiber (2 required)

**RLY-5** – Relay module, provides 5 form C relay contacts rated at 3.0 amps 24VDC/125AC

**SPG-1000** – Serial parallel gateway, allows for the connection to a serial or parallel printer

The **FIB-1000**, **FCB-1000** and the **SPG-1000** may be installed in the stacker bracket or ordered with the optional rack mount enclosure.

**MC-1000** Multi-Connect allows up to sixty-three AFC series panels to share a single reporting technology.

**IDC-6** – Initiating device circuit provides 6 programmable inputs

**AE-2** – Two card expansion cabinet

**AE-8** – Eight card expansion cabinet

**AE-14** – Fourteen card expansion cabinet


## Ethernet/I.P. Connection

The AFC-1000 is shipped standard with an Ethernet connection.

This connection is the programming port and may be connected to a building Wide Area Network (WAN) or Local Area Network (LAN). Once connected to the Internet, the panel may be selectively programmed to e-mail alarm conditions, trouble conditions, supervisory conditions, test, Event History and detector status. An e-mail may be sent to the panel and the panel will e-mail the event history, detector status, configuration file or server status to an authorized E-mail account. In addition, reminders may be set to send an e-mail for service, testing or other conditions.

In addition, the Ethernet connection is UL listed as an IP communicator. The IP communicator is listed to report to the UL listed Sur-Gard III IP receiver. The IP communicator replaces the traditional less reliable alarm communicator transmitter that utilized telephone lines. The IP communicator is an active method of connection and communication to the monitoring station.

## Dimensions

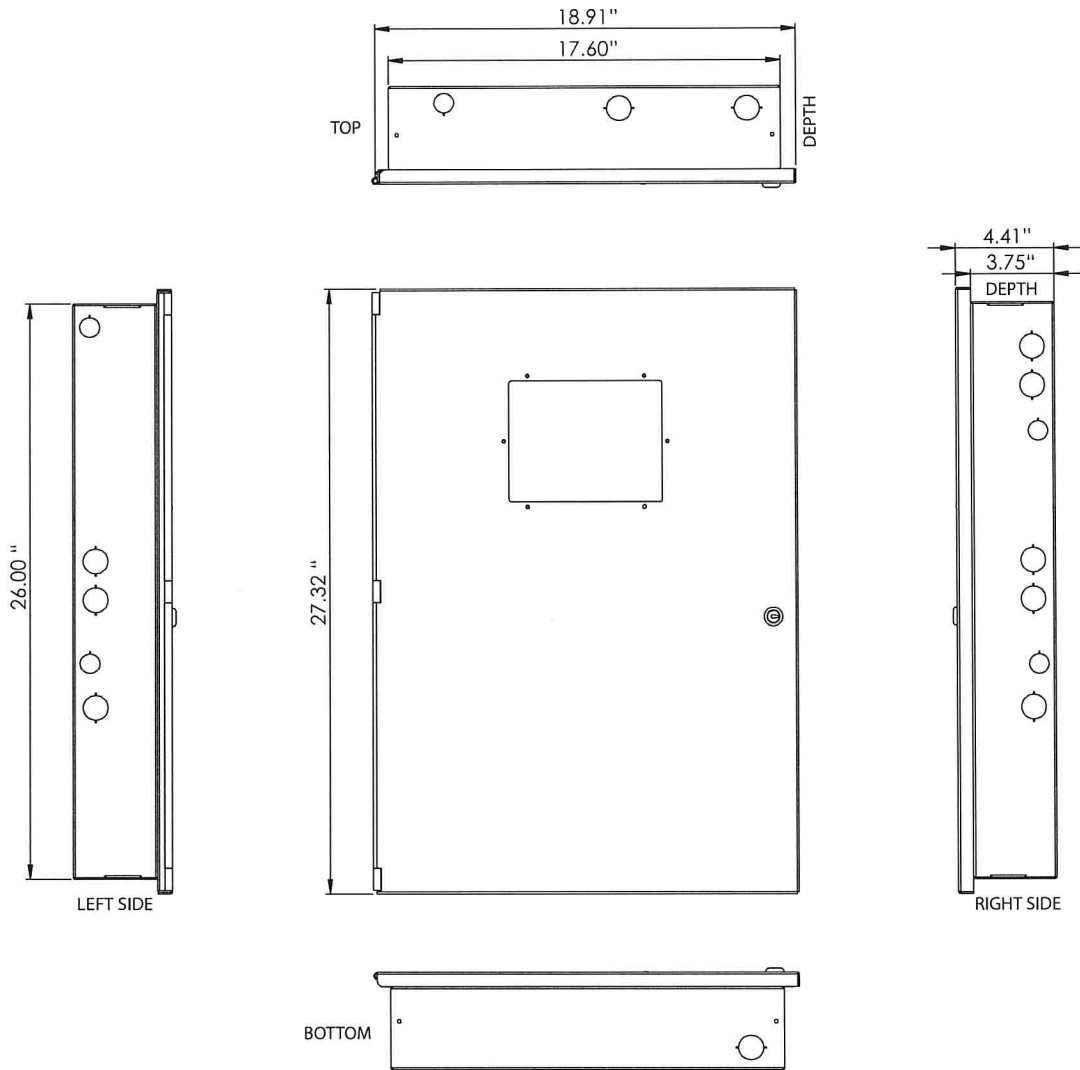

## Ordering Information

Model	Description	Stock No.
AFC-1000	Fire Alarm Control Panel	3992754
	Replacement Board AFC-1000	3992758

## Features

- Single module with dual contact monitoring inputs
- Two (2) Class B or one (1) Class A monitoring inputs
- SLC Class A, Class X & Class B
- Mounts in a standard 4" or double gang box
- Wiring terminals accessible when mounted in box
- All wiring terminals accept 22 to 12 AWG
- Product includes a 5 year warranty
- UUKL Listed for Smoke Control

**NOTE:** This addressable module does not support 2-wire smoke detectors.



## Description

The PAD100-DIM uses one (1) SLC loop address when monitoring two (2) Class B circuits or one (1) Class A circuit. The module mounts on either a 4" square or double gang box. The module is capable of monitoring two (2) separate class B circuits making it ideal for monitoring sprinkler waterflow and valve tamper switches when they are located in the same proximity. The PAD100-DIM includes one red LED to indicate the module's status. In normal condition, the LED flashes when the device is being polled by the control panel. When an input is activated, the LED will flash at a fast rate.

## Application

The PAD100-DIM is compatible with Potter's IPA and AFC/ARC series addressable fire alarm control panels. The PAD100-DIM is an interface module used to monitor dry contact devices such as sprinkler waterflow, valve tamper switches, or conventional pull stations. The module is capable of monitoring two separate Class B or one Class A circuits.

## Setting the Address

Each addressable SLC device must be assigned an address. The address is set using the DIP switch located on the PAD100-DIM. When the PAD100-DIM is used to monitor two individual Class B circuits a single device address is assigned, each input is then identified as a sub-point of the module address. For example, if the address number is assigned as "8", the first input will be "8.1" and the second input will be "8.2".

Before connecting a device to the SLC loop, take the following precautions to prevent potential damage to the panel or device:

1. Power to the device is removed.
2. Field wiring is correctly installed.
3. Field wiring has no open or short circuits.


## Technical Specifications

Operating Voltage	24.0V
Max SLC Standby Current	240 $\mu$ A
Max SLC Alarm Current	240 $\mu$ A
Max Wiring Resistance of IDC	100 $\Omega$
Max Wiring Capacitance of IDC	1 $\mu$ F
EOL Resistor	5.1K $\Omega$
Operating Temperature Range	32 to 120°F (0 to 49°C)
Operating Humidity Range	0 to 93% (non-condensing)
Max no. of Module Per Loop	127 units
Dimensions	4.17" (106mm)L $\times$ 4.17" (106mm)W $\times$ 1.14" (29mm)D
Mounting Options	Standard 4" Square or Double Gang Box
Shipping Weight	0.6 lbs



## Installation Using Compatible Electrical Box


Fig 1

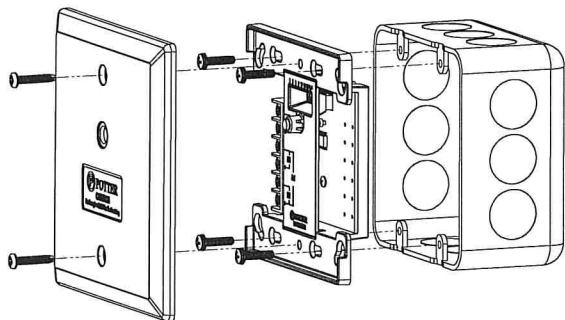

## Wiring Diagrams


### PAD100-DIM With One Class A Circuit

Fig 2

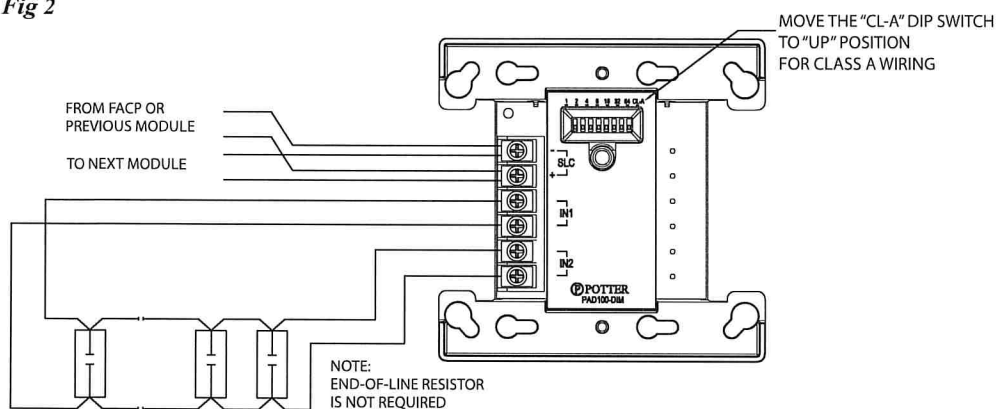

### PAD100-DIM With Two Class B Circuits

Fig 3

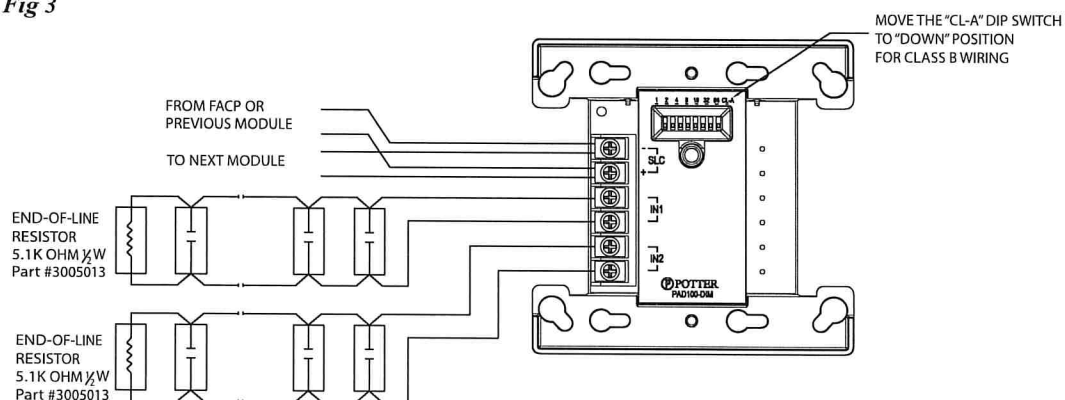

## Ordering Information

Model	Description	Stock No.
PAD100-DIM	Dual Input Module	3992703



## Features

- 24VDC units have field selectable candela options of 15, 30, 60, 75 & 110
- Super-Slide® Bracket - Ease of Supervision Testing
- Checkmate® - Instant Voltage Verification
- Synchronize strobe and/or horn with AVSM Control Module
- Prewire entire system, install mounting bracket, then install signals
- Documented lower installation and operating costs
- Switch selection for high or low dBA
- Switch for chime, whoop, mechanical and 2400Hz tone
- Tamperproof re-entrant style grill
- Switch for continuous or temporal 3 tone (not available on whoop tone)
- Silence audible while visual appliance will remain flashing (for use in accepted jurisdictions)
- Faceplate available in red or off-white



## Description

The S-24/HS-24 Series is a low profile strobe and horn/strobe combination that offers dependable audible and visual alarms and the absolute lowest current available. The S-24 & HS-24 Series 24VDC offers tamperproof field selectable candela options of 15, 30, 60, 75, and 110 candela. The Strobe and Horn/Strobe offers a continuous or sync temporal three in 2400Hz and mechanical tone, a chime and whoop tone. All tones are easy for the professional to change in the field by the use of switches. The S-24 & HS-24 Series has a minimal operating current and has a minimum flash rate of 1Hz regardless of input voltage.

This Series is shipped with a standard 4" metal mounting plate which incorporates the popular Super-Slide® feature that allows the installer to easily test for supervision. The product also features a locking mechanism which secures the product to the bracket without any screws showing.

The S-24/HS-24 also features the patented Checkmate® - Instant Voltage Verification feature which allows the installer to check the voltage drop draw and match it to the blueprint.

The S-24 & HS-24 Series appliances are ANSI/UL 464 and ANSI/UL 1971, listed for use with fire protective systems and are warranted for three years from date of purchase.

## Technical Specifications


Mounting Options	Single or Double gang, 4" square box, and AVBB surface mount back box
Terminals	Screw-Clamp Type
Wire Gauge	18 – 12 AWG
Operating Temp	32°F – 120°F (0° – 49°C)
Dimensions	Height – 5" Width – 4.5" Depth – 2.5"
Shipping Weight	1.05 lbs

TONE	SWITCH POSITION		
	3	4	5
Mechanical Temporal 3	ON	ON	ON
Mechanical Continuous	OFF	ON	ON
2400 Hz Temporal 3	ON	OFF	ON
2400 Hz Continuous	OFF	OFF	ON
Chime Temporal 3	ON	ON	OFF
Chime Continuous	OFF	ON	OFF
Whoop	ON	OFF	OFF
Whoop	OFF	OFF	OFF

**NOTE:**

- Switch Positions 1The and 2 in the OFF position to select isolated horn and strobe power inputs
- Switch Position 6 ON = HIGH dBA
- Switch Position 6 OFF = LOW dBA


**Candela Selection**

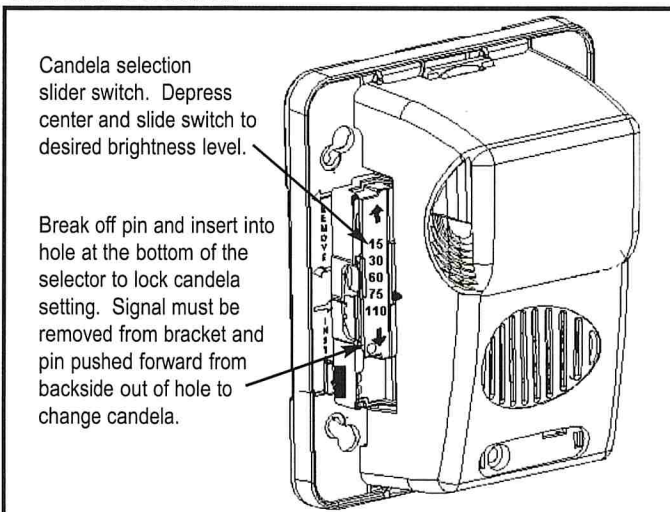



**Super Slide® Mounting Bracket**

Allows the installer to pre-wire the system, test for system supervision, remove the signal head until occupancy, switch out signals without changing mounting brackets and has locking edge connector for snap-in-place installation.

**Switch Locations**

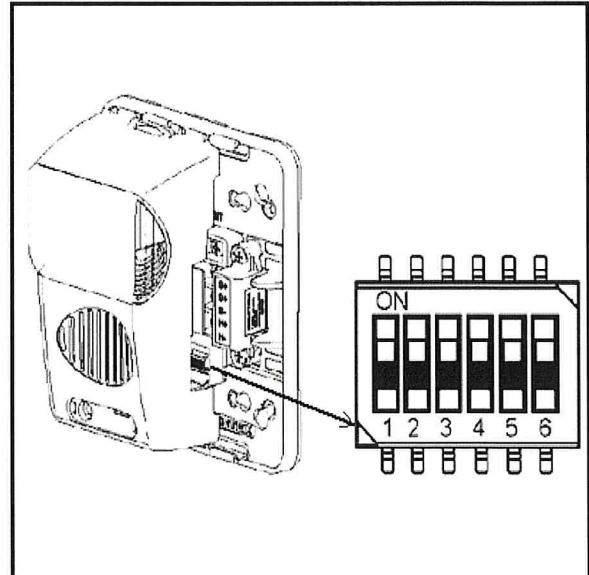

**Checkmate™ - Instant Voltage Verification**

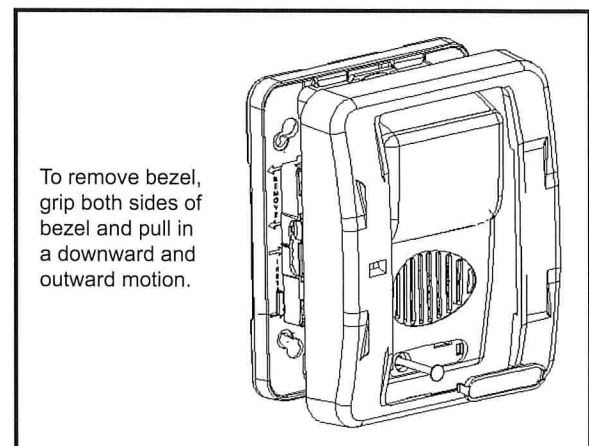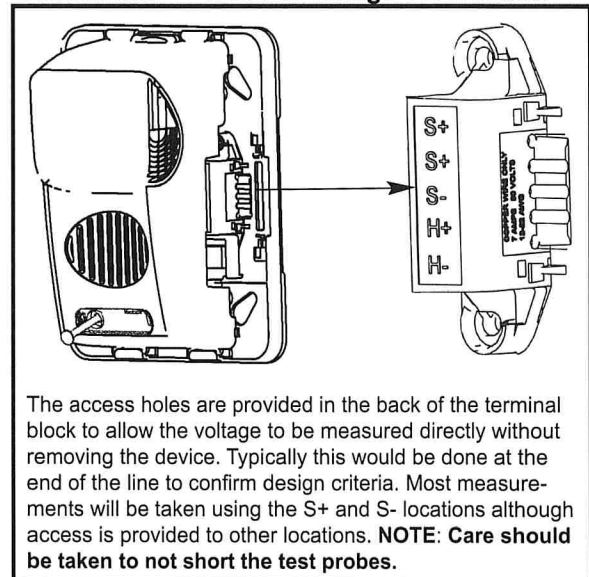



## S-24 24 VDC Selectable Candela, Low Profile Evacuation Strobe

Model Number	Part Number	Nominal Voltage	Candela (ANSI/UL 1971)
S-24WR	4890010	24 VDC	15, 30, 60, 75, 110
S-24WW	4890011	24 VDC	15, 30, 60, 75, 110

## HS-24 24 VDC Selectable Candela, Low Profile Evacuation Strobe

Model Number	Part Number	Nominal Voltage	Candela (ANSI/UL 1971)	Reverberant dBA at 10 ft, per ANSI/UL 464	In Anechoic Room at 10 ft
HS-24WR	4890030	24 VDC	15, 30, 60, 75, 110	62-82	100
HS-24WW	4890031	24 VDC	15, 30, 60, 75, 110	62-82	100

## S-24 & HS 24 Strobe Current Ratings

24 VDC (16 - 33 Volts)		
Candela	24 VDC	UL Max
15 cd	30 mA	42 mA
30 cd	35 mA	58 mA
60 cd	66 mA	97 mA
75 cd	80 mA	116 mA
110 cd	103 mA	161 mA

### Model Designations:

W = Wall mount  
R = Red Faceplate      W=White Faceplate

All units are available in plain (no lettering)  
Plain units are non-returnable.

“ALERT” bezel available for order.

“AGENT” bezel available for order.

## S-24 & HS-24 Horn Ratings


Horn Mode	Horn Decibel Levels		Horn Current Ratings
	Minimum SPL at 10 ft, per ANSI/UL 464 (HIGH)	Minimum SPL at 10 ft, per ANSI/UL 464 (LOW)	Regulated 24 VDC Max Operating @ High Setting (mA)
Temp 3 (2400 Hz)	78 dBA	71* dBA	28 mA
Temp 3 (Mechanical)	76 dBA	70* dBA	25 mA
Temp 3 (Chime)	70* dBA	66* dBA	15 mA
Continuous (2400 Hz)	81 dBA	74* dBA	28 mA
Continuous (Mechanical)	80 dBA	72* dBA	25 mA
Continuous (Chime)	70* dBA	66* dBA	15 mA
Whoop	82 dBA	69* dBA	56 mA

### NOTES:

- For nominal and peak current across ANSI/UL regulated voltage range for filtered DC power and unfiltered (FWR [Full Wave Rectified]) power see installation manual.
- Potter does not recommend using a coded or pulsing signaling circuit with any of our strobe products.
- The sound output for the temporal 3 tone is rated lower since the time the horn is off is averaged into the sound output rating. While the horn is producing a tone in the temporal 3 mode its sound pressure is the same as the continuous mode.
- \* Operating the horn in this mode at this voltage will result in not meeting the minimum ANSI/UL 464 reverberant sound level required for public mode fire protection service. These settings are acceptable only for private mode fire alarm use. Use the high dBA setting for public mode application (not applicable when using the chime tone. The chime tone is always private mode).



## S-24 & HS-24 Series Wiring Diagram

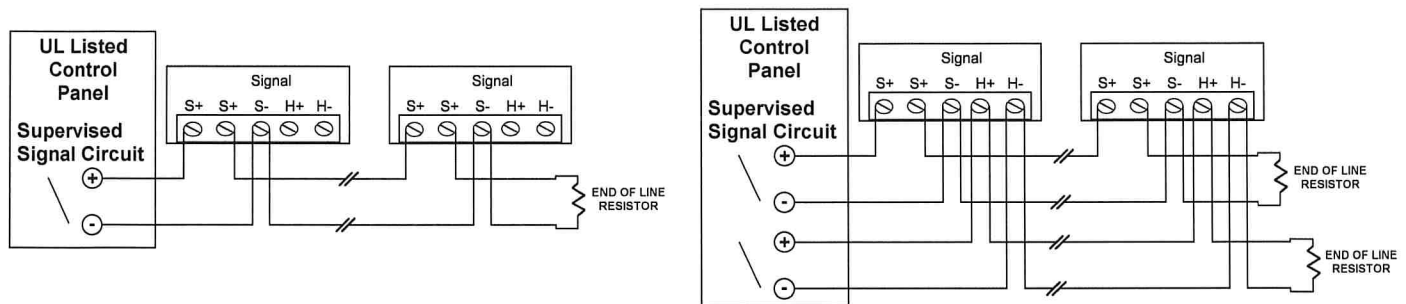

### Notes:

All strobes are designed to flash as specified with continuous applied voltage. Strobes should not be used on coded or pulsing signaling circuits. However, use of the Potter AVSM control module or Gentex synchronization protocol is permitted to synchronize the strobe, horn, and/or mute the horn.

• FOR SYNCHRONIZATION WIRING INFORMATION, REFERENCE AVSM CONTROL MODULE DATA SHEET (8830050) AND/OR AVSM CONTROL MODULE MANUAL FOR SYNCHRONIZATION MODULE WIRING DIAGRAMS. AVSM CONTROL MODULE DATA SHEET AND MANUAL CAN BE OBTAINED AT <http://pottersignal.com> OR CALL POTTER ELECTRIC TECHNICAL SUPPORT AT 1-866-956-1211

## Architect & Engineering Specifications

The audible and/or visible signal shall be Potter S-24 strobe and Potter HS-24 horn/strobe Series or approved equal and shall be listed by Underwriters Laboratories, Inc. per ANSI/UL 1971 and/or ANSI/UL 464. The notification appliance shall also be listed with Factory Mutual Listing Service (FM) and the California State Fire Marshal (CSFM).

The notification appliance (combination audible/visible) shall produce a peak sound output of 100dBA or greater at 24VDC as measured in an anechoic chamber. The signaling appliance shall also have the capability to silence the audible signal while leaving the visible signal energized with the use of a single pair of power wires. Additionally, the user shall be able to select either continuous or temporal tone output with the temporal signal having the ability to be synchronized.

Unit shall be capable of being installed so that any unauthorized attempt to change the candela setting will result in a trouble signal at the fire alarm control panel.

The audible/visible and visible signaling appliance shall also maintain a minimum flash rate of 1Hz or up to 2Hz regardless of power input voltage. The strobe appliance shall have an operating current of 42mA or less at 24VDC for the 15Cd strobe circuit.

The appliance shall be polarized to allow for electrical supervision of the system wiring. The unit shall be provided with a mounting bracket with terminals and barriers for input/output wiring and be able to mount to a single gang or double gang box or double workbox without the use of an adapter plate. The unit shall have an input voltage range of 16-33 volts with either direct current or full wave rectified power for 24VDC models.

The appliance shall be capable of testing supervision without disconnecting wires, verify voltage without removing unit and be capable of mounting to a surface back box.